

# ECODESIGN & ENERGY LABELLING INFORMATION

4.3 KW SPLIT TANK COMBI

**HITACHI**  
Inspire the Next



# INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Hitachi YUTAKI Split Tank Combi air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

# DECLARATION OF CONFORMITY

## Product details

**Product:** HTIACHI YUTAKI S COMBI  
**Model(s):** RAS-2WHVRP / RWD-2.0NRWE-200S



## Declaration & Applicable Standards

The product above is in compliance with the following directives.  
Of the European Parliament and of the Council of the European Union :

2014/35/EU (2006/95/EC)  
2014/30/EU (2004/108/EC)  
2011/65/EU  
813/2013 2009/125/EC

<b>EN60335-1</b>	<b>EN60335-2-40</b>
<b>EN55014-1</b>	<b>EN55014-2</b>
<b>EN61000-3-3</b>	<b>EN61000-3-2</b>
<b>EN6100-3-11</b>	<b>EN61000-3-12</b>
<b>EN62233</b>	<b>EN14825</b>
<b>EN16147</b>	<b>EN12102</b>

# TECHNICAL PARAMETERS – LOW TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013


model				RAS-2WHVRP / RWD-2.ONRWE-200S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	4.00	KW	Seasonal Space Heating Energy Efficiency	N <sup>s</sup>	181	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	3.54	KW	Tj = -7 °C	COPd	3.20	-
Tj = +2 °C	Pdh	2.35	KW	Tj = +2 °C	COPd	4.80	-
Tj = +7 °C	Pdh	3.00	KW	Tj = +7 °C	COPd	6.20	-
Tj = +12 °C	Pdh	3.05	KW	Tj = +12 °C	COPd	8.30	-
Tj = operation limit temperature	Pdh	4.00	KW	Tj = operation limit temperature	COPd	2.75	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.012	KW	Rated heat output	Psup	0.00	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.012	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	61	dB
For heat pump combination heater							
<b>Declared load profile</b>		L		<b>Water heating energy Efficiency</b>	Nwh	132	%
Primary standby heat loss		1.75	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		263	L

# TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				RAS-2WHVRP / RWD-2.ONRWE-200S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	4.00	KW	Seasonal Space Heating Energy Efficiency	N <sup>s</sup>	133	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	3.50	KW	Tj = -7 °C	COPd	2.13	-
Tj = +2 °C	Pdh	2.10	KW	Tj = +2 °C	COPd	3.35	-
Tj = +7 °C	Pdh	2.43	KW	Tj = +7 °C	COPd	5.15	-
Tj = +12 °C	Pdh	2.80	KW	Tj = +12 °C	COPd	6.80	-
Tj = operation limit temperature	Pdh	3.10	KW	Tj = operation limit temperature	COPd	1.90	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	00.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.012	KW	Rated heat output	Psup	0.90	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.012	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	61	dB
For heat pump combination heater							
<b>Declared load profile</b>		L		<b>Water heating energy Efficiency</b>	Nwh	132	%
Primary standby heat loss		1.75	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		263	L

# PRODUCT LABELS – HEAT PUMP COMBINATION HEATER

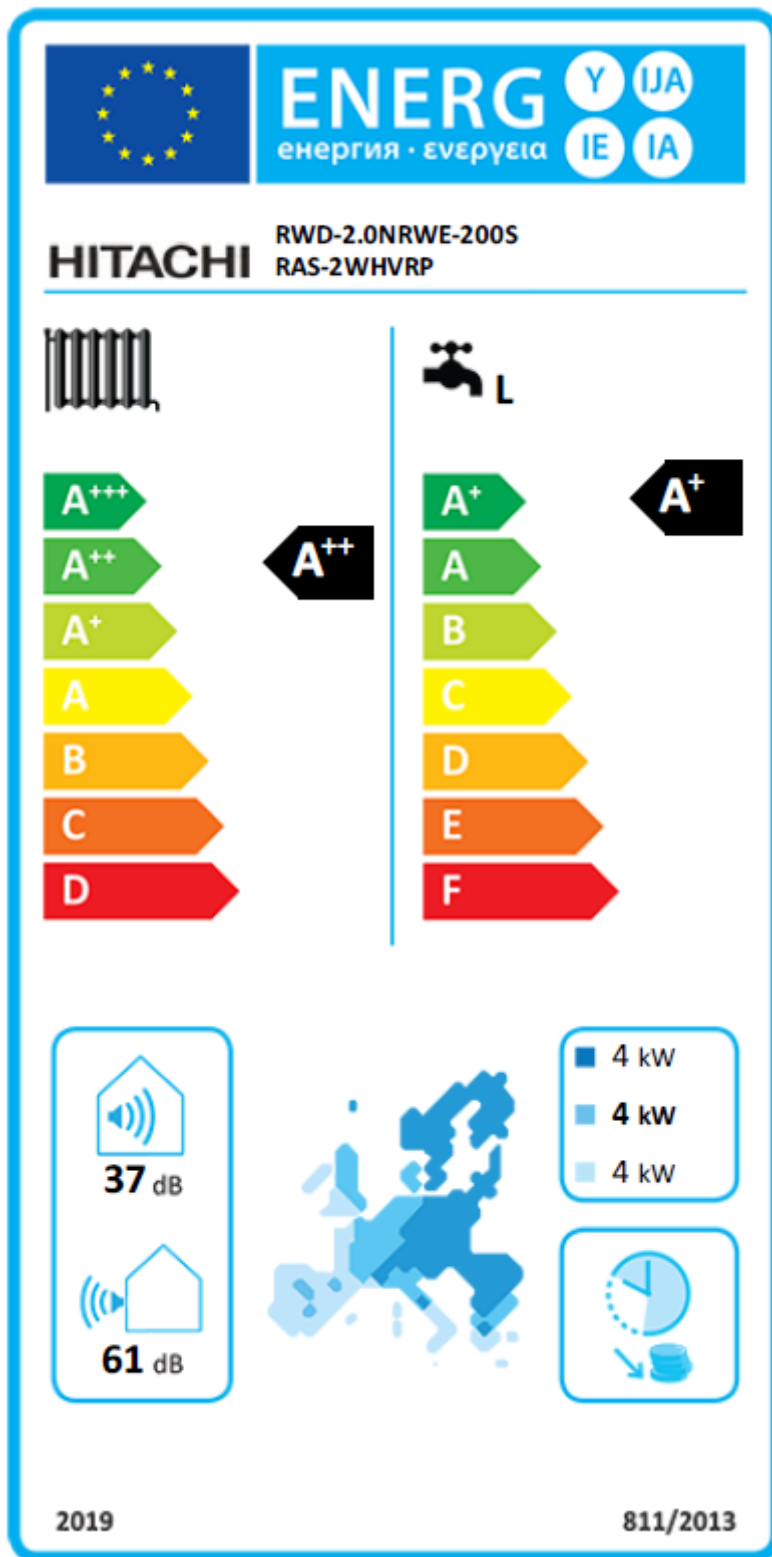



**For any queries on any information in this guide  
or if you require anymore information please contact:**

PIPELIFE Ireland Limited, White's Cross, Cork,  
1B Damastown Way, Mulhuddart, Dublin 15,  
**T** +353 21 488 4700, **F** +353 21 488 4701,  
**E** [ireland@pipelife.com](mailto:ireland@pipelife.com) **pipelife.ie**