


ECODESIGN & ENERGY LABELLING INFORMATION

HITACHI
Inspire the Next



CONTENTS

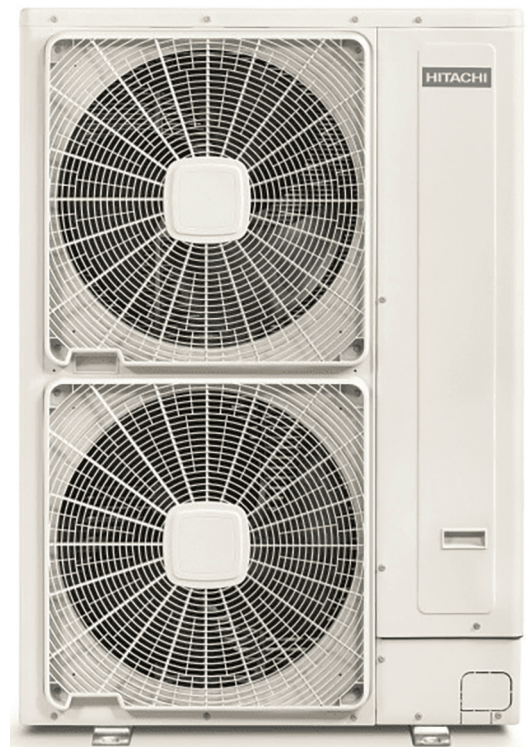

4.3 KW SPLIT TANK COMBI	3
6 KW SPLIT TANK COMBI	8
7.5 KW SPLIT TANK COMBI	13
11 KW SPLIT TANK COMBI	18
14 KW SPLIT TANK COMBI	23
16 KW SPLIT TANK COMBI	28

HITACHI
Inspire the Next

4.3 KW SPLIT TANK COMBI

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Hitachi YUTAKI Split Tank Combi air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: HTIACHI YUTAKI S COMBI
Model(s): RAS-2WHVRP / RWD-2.0NRWE-200S



Declaration & Applicable Standards

The product above is in compliance with the following directives.
Of the European Parliament and of the Council of the European Union :

2014/35/EU (2006/95/EC)
2014/30/EU (2004/108/EC)
2011/65/EU
813/2013 2009/125/EC

EN60335-1	EN60335-2-40
EN55014-1	EN55014-2
EN61000-3-3	EN61000-3-2
EN6100-3-11	EN61000-3-12
EN62233	EN14825
EN16147	EN12102

TECHNICAL PARAMETERS – LOW TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013


model				RAS-2WHVRP / RWD-2.ONRWE-200S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	4.00	KW	Seasonal Space Heating Energy Efficiency	N ^s	181	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	3.54	KW	Tj = -7 °C	COPd	3.20	-
Tj = +2 °C	Pdh	2.35	KW	Tj = +2 °C	COPd	4.80	-
Tj = +7 °C	Pdh	3.00	KW	Tj = +7 °C	COPd	6.20	-
Tj = +12 °C	Pdh	3.05	KW	Tj = +12 °C	COPd	8.30	-
Tj = operation limit temperature	Pdh	4.00	KW	Tj = operation limit temperature	COPd	2.75	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.012	KW	Rated heat output	Psup	0.00	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.012	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	61	dB
For heat pump combination heater							
Declared load profile		L		Water heating energy Efficiency	Nwh	132	%
Primary standby heat loss		1.75	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		263	L

TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				RAS-2WHVRP / RWD-2.ONRWE-200S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	4.00	KW	Seasonal Space Heating Energy Efficiency	N ^s	133	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	3.50	KW	Tj = -7 °C	COPd	2.13	-
Tj = +2 °C	Pdh	2.10	KW	Tj = +2 °C	COPd	3.35	-
Tj = +7 °C	Pdh	2.43	KW	Tj = +7 °C	COPd	5.15	-
Tj = +12 °C	Pdh	2.80	KW	Tj = +12 °C	COPd	6.80	-
Tj = operation limit temperature	Pdh	3.10	KW	Tj = operation limit temperature	COPd	1.90	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	00.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.012	KW	Rated heat output	Psup	0.90	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.012	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	61	dB
For heat pump combination heater							
Declared load profile		L		Water heating energy Efficiency	Nwh	132	%
Primary standby heat loss		1.75	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		263	L

PRODUCT LABELS – HEAT PUMP COMBINATION HEATER

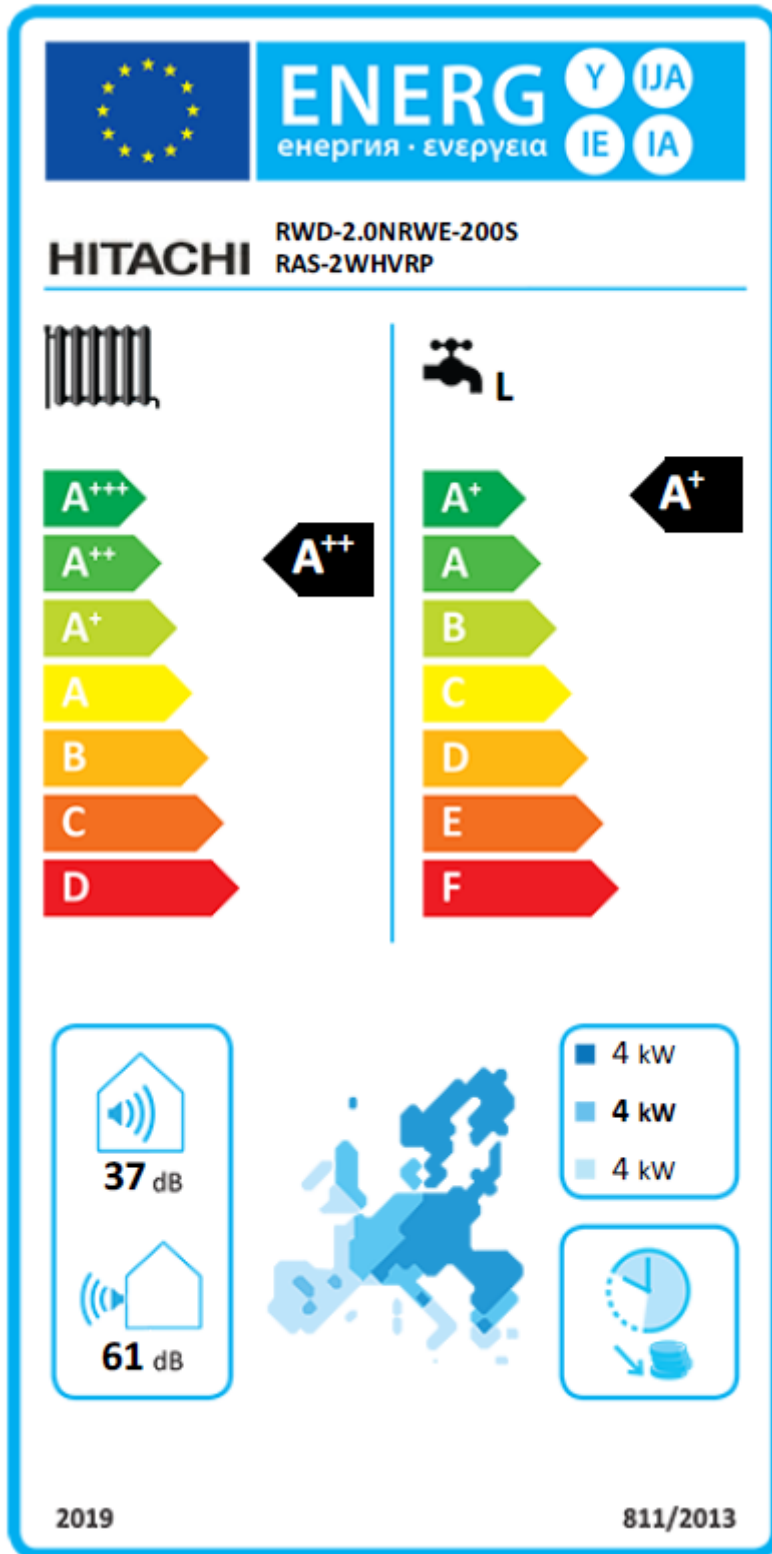

HITACHI
Inspire the Next

6 KW SPLIT TANK COMBI

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Hitachi YUTAKI Split Tank Combi air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: HTIACHI YUTAKI S COMBI
Model(s): RAS-2.5WHVRP / RWD-2.5NRWE-200S



Declaration & Applicable Standards

The product above is in compliance with the following directives.
Of the European Parliament and of the Council of the European Union:

2014/35/EU (2006/95/EC)
2014/30/EU (2004/108/EC)
2011/65/EU
813/2013 2009/125/EC

EN60335-1	EN60335-2-40
EN55014-1	EN55014-2
EN61000-3-3	EN61000-3-2
EN6100-3-11	EN61000-3-12
EN62233	EN14825
EN16147	EN12102

TECHNICAL PARAMETERS – LOW TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013


model				RAS-2.5WHVRP / RWD-2.5NRWE-200S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	6	KW	Seasonal Space Heating Energy Efficiency	N ^s	177	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	5.10	KW	Tj = -7 °C	COPd	2.70	-
Tj = +2 °C	Pdh	3.10	KW	Tj = +2 °C	COPd	4.60	-
Tj = +7 °C	Pdh	3.00	KW	Tj = +7 °C	COPd	6.20	-
Tj = +12 °C	Pdh	3.05	KW	Tj = +12 °C	COPd	8.35	-
Tj = operation limit temperature	Pdh	5.30	KW	Tj = operation limit temperature	COPd	2.50	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.012	KW	Rated heat output	Psup	0.25	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.012	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	63	dB
For heat pump combination heater							
Declared load profile	L			Water heating energy Efficiency	Nwh	132	%
Primary standby heat loss	1.75	KWh/day		Reference hot water temperature		54	°C
				DHW volume accounted for in test		263	L

TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				RAS-2.5WHVRP / RWD-2.5NRWE-200S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	5.00	KW	Seasonal Space Heating Energy Efficiency	N ^s	127	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	4.42	KW	Tj = -7 °C	COPd	1.85	-
Tj = +2 °C	Pdh	2.69	KW	Tj = +2 °C	COPd	3.30	-
Tj = +7 °C	Pdh	2.43	KW	Tj = +7 °C	COPd	4.60	-
Tj = +12 °C	Pdh	2.80	KW	Tj = +12 °C	COPd	6.35	-
Tj = operation limit temperature	Pdh	3.90	KW	Tj = operation limit temperature	COPd	1.70	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	00.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.012	KW	Rated heat output	Psup	1.10	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.012	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	63	dB
For heat pump combination heater							
Declared load profile		L		Water heating energy Efficiency	Nwh	132	%
Primary standby heat loss		1.75	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		263	L

PRODUCT LABELS – HEAT PUMP COMBINATION HEATER

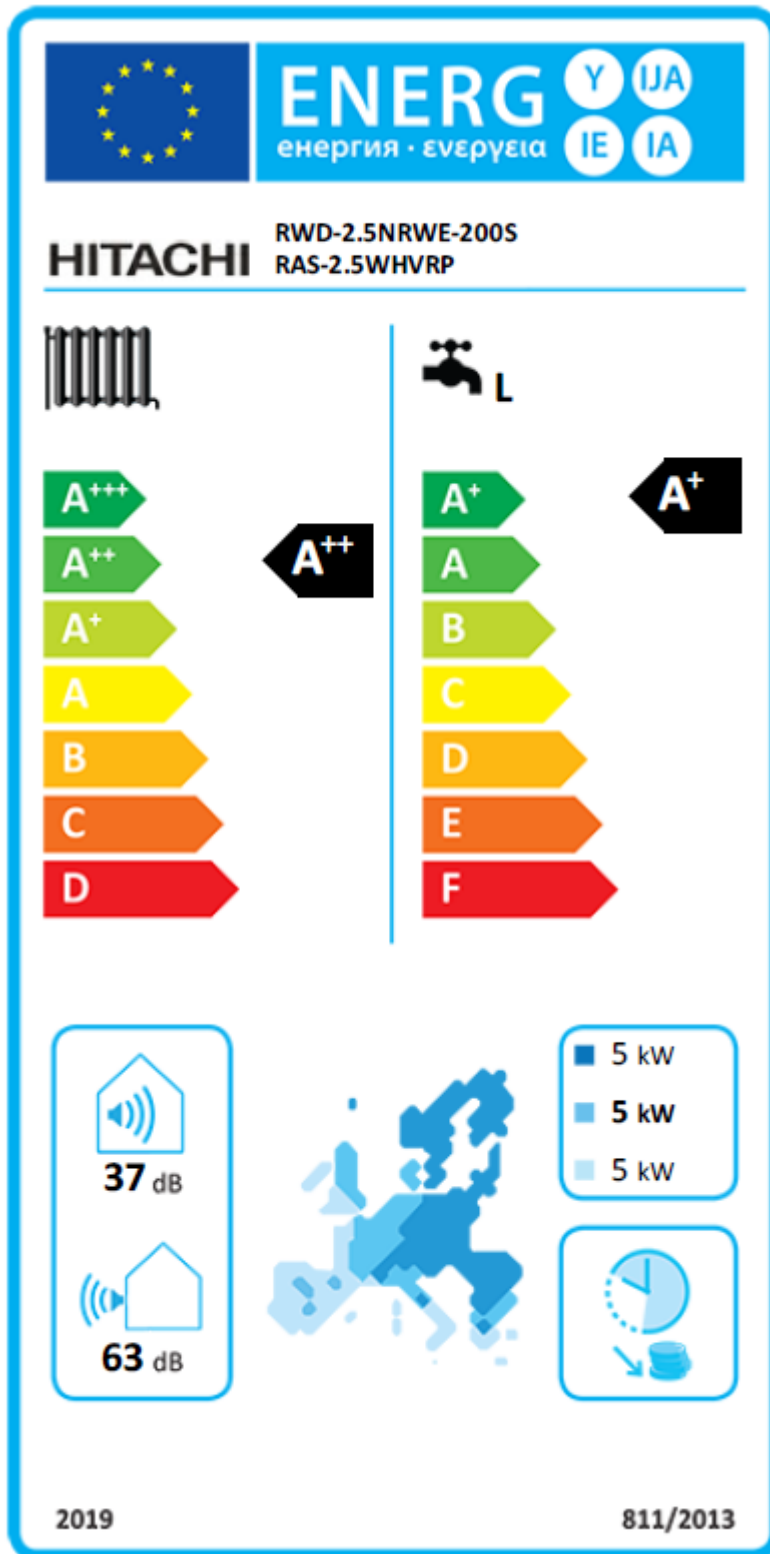

HITACHI
Inspire the Next

7.5 KW SPLIT TANK COMBI

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Hitachi YUTAKI Split Tank Combi air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: HTIACHI YUTAKI S COMBI
Model(s): RAS-3WHVRP / RWD-3.0NRWE-260S



Declaration & Applicable Standards

The product above is in compliance with the following directives.
Of the European Parliament and of the Council of the European Union:

2014/35/EU (2006/95/EC)
2014/30/EU (2004/108/EC)
2011/65/EU
813/2013 2009/125/EC

EN60335-1	EN60335-2-40
EN55014-1	EN55014-2
EN61000-3-3	EN61000-3-2
EN6100-3-11	EN61000-3-12
EN62233	EN14825
EN16147	EN12102

TECHNICAL PARAMETERS – LOW TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013


model				RAS-3WHVRP / RWD-3.ONRWE-260S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	7	KW	Seasonal Space Heating Energy Efficiency	N ^s	177	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	5.90	KW	Tj = -7 °C	COPd	2.65	-
Tj = +2 °C	Pdh	3.59	KW	Tj = +2 °C	COPd	4.30	-
Tj = +7 °C	Pdh	3.20	KW	Tj = +7 °C	COPd	7.00	-
Tj = +12 °C	Pdh	3.50	KW	Tj = +12 °C	COPd	9.70	-
Tj = operation limit temperature	Pdh	6.40	KW	Tj = operation limit temperature	COPd	2.30	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	Tbiv	-10	°C
Degradation co-efficient	Cdh	0.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.012	KW	Rated heat output	Psup	0.60	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.012	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	67	dB
For heat pump combination heater							
Declared load profile	XL			Water heating energy Efficiency	Nwh	136	%
Primary standby heat loss	1.85	KWh/day		Reference hot water temperature		54	°C
				DHW volume accounted for in test		350	L

TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				RAS-3WHVRP / RWD-3.ONRWE-200S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	6.00	KW	Seasonal Space Heating Energy Efficiency	N ^s	125	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	5.10	KW	Tj = -7 °C	COPd	1.84	-
Tj = +2 °C	Pdh	3.10	KW	Tj = +2 °C	COPd	3.10	-
Tj = +7 °C	Pdh	2.00	KW	Tj = +7 °C	COPd	4.65	-
Tj = +12 °C	Pdh	2.20	KW	Tj = +12 °C	COPd	6.55	-
Tj = operation limit temperature	Pdh	5.00	KW	Tj = operation limit temperature	COPd	1.50	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	00.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.012	KW	Rated heat output	Psup	1.50	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.012	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	69	dB
For heat pump combination heater							
Declared load profile		L		Water heating energy Efficiency	Nwh	136	%
Primary standby heat loss		1.75	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		350	L

PRODUCT LABELS – HEAT PUMP COMBINATION HEATER

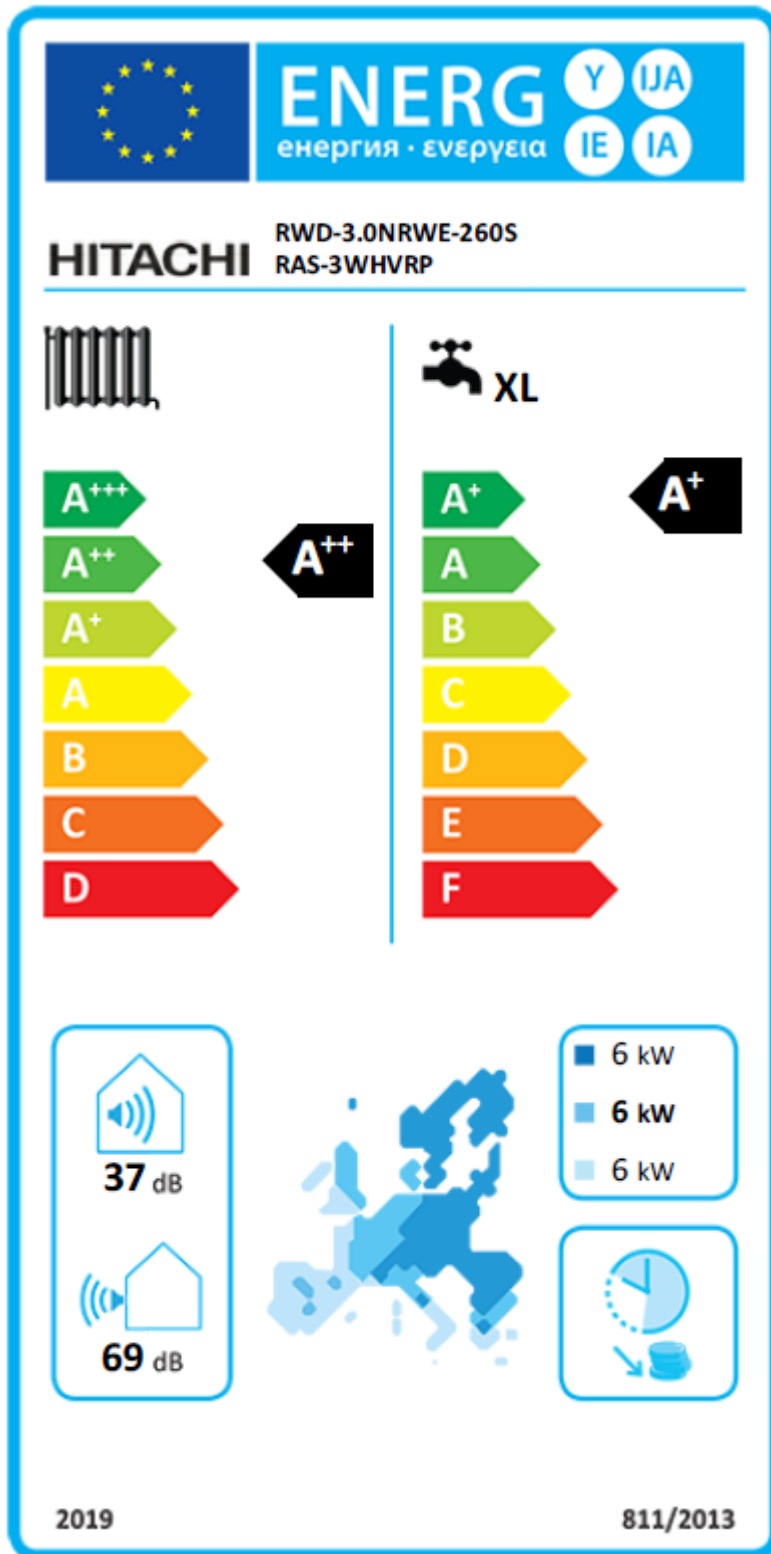

HITACHI
Inspire the Next

11 KW SPLIT TANK COMBI

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Hitachi YUTAKI Split Tank Combi air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: HTIACHI YUTAKI S COMBI
Model(s): RAS-4WHVNPE / RWD-4NWE-260S



Declaration & Applicable Standards

The product above is in compliance with the following directives.
Of the European Parliament and of the Council of the European Union:

2014/35/EU (2006/95/EC)
2014/30/EU (2004/108/EC)
2011/65/EU
813/2013 2009/125/EC

EN60335-1	EN60335-2-40
EN55014-1	EN55014-2
EN61000-3-3	EN61000-3-2
EN6100-3-11	EN61000-3-12
EN62233	EN14825
EN16147	EN12102

TECHNICAL PARAMETERS – LOW TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013


model				RAS-4WHVNPE / RWD-4NWE-260S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	11	KW	Seasonal Space Heating Energy Efficiency	N ^s	187	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	9.60	KW	Tj = -7 °C	COPd	2.74	-
Tj = +2 °C	Pdh	5.84	KW	Tj = +2 °C	COPd	5.20	-
Tj = +7 °C	Pdh	3.76	KW	Tj = +7 °C	COPd	5.80	-
Tj = +12 °C	Pdh	3.70	KW	Tj = +12 °C	COPd	6.40	-
Tj = operation limit temperature	Pdh	10.50	KW	Tj = operation limit temperature	COPd	2.65	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.013	KW	Rated heat output	Psup	0.50	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.013	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	64	dB
For heat pump combination heater							
Declared load profile	XL			Water heating energy Efficiency	Nwh	134	%
Primary standby heat loss	1.85	KWh/day		Reference hot water temperature		54	°C
						DHW volume accounted for in test	350 L

TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				RAS-4WHVNPE / RWD-4NWE-260S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	10	KW	Seasonal Space Heating Energy Efficiency	N ^s	134	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	8.60	KW	Tj = -7 °C	COPd	1.80	-
Tj = +2 °C	Pdh	5.23	KW	Tj = +2 °C	COPd	3.60	-
Tj = +7 °C	Pdh	3.52	KW	Tj = +7 °C	COPd	4.80	-
Tj = +12 °C	Pdh	3.60	KW	Tj = +12 °C	COPd	5.80	-
Tj = operation limit temperature	Pdh	7.40	KW	Tj = operation limit temperature	COPd	1.70	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	00.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.013	KW	Rated heat output	Psup	2.30	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.013	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	64	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency	Nwh	134	%
Primary standby heat loss		1.85	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		350	L

PRODUCT LABELS – HEAT PUMP COMBINATION HEATER

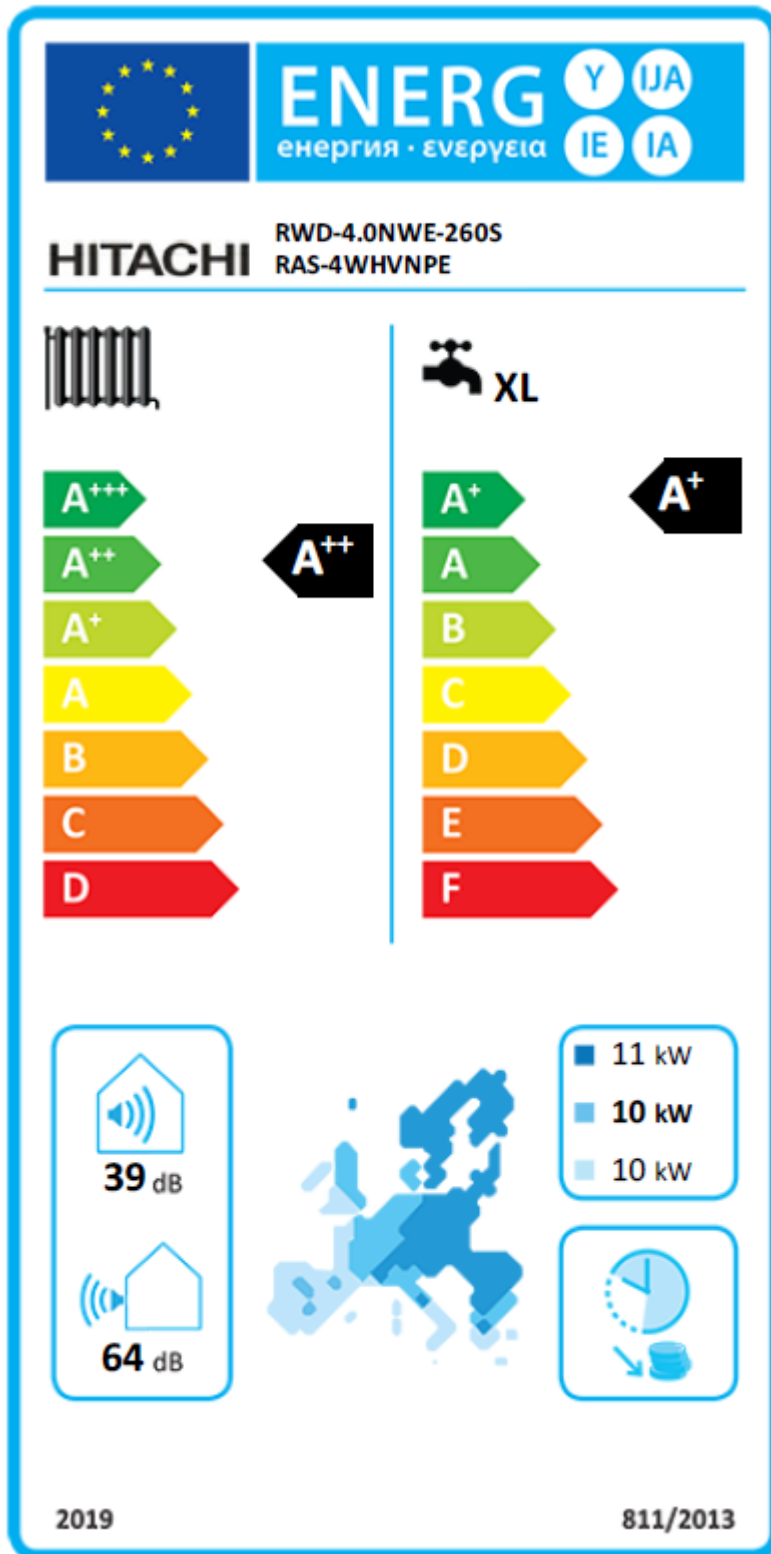

HITACHI
Inspire the Next

14 KW SPLIT TANK COMBI

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Hitachi YUTAKI Split Tank Combi air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: HTIACHI YUTAKI S COMBI
Model(s): RAS-5WHVNPE / RWD-5NWE-260S



Declaration & Applicable Standards

The product above is in compliance with the following directives.
Of the European Parliament and of the Council of the European Union:

2014/35/EU (2006/95/EC)
2014/30/EU (2004/108/EC)
2011/65/EU
813/2013 2009/125/EC

EN60335-1	EN60335-2-40
EN55014-1	EN55014-2
EN61000-3-3	EN61000-3-2
EN6100-3-11	EN61000-3-12
EN62233	EN14825
EN16147	EN12102

TECHNICAL PARAMETERS – LOW TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013


model				RAS-5WHVNPE / RWD-5NWE-260S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	14	KW	Seasonal Space Heating Energy Efficiency	N ^s	175	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	12.00	KW	Tj = -7 °C	COPd	2.55	-
Tj = +2 °C	Pdh	7.30	KW	Tj = +2 °C	COPd	4.70	-
Tj = +7 °C	Pdh	4.70	KW	Tj = +7 °C	COPd	5.70	-
Tj = +12 °C	Pdh	3.50	KW	Tj = +12 °C	COPd	6.00	-
Tj = operation limit temperature	Pdh	12.10	KW	Tj = operation limit temperature	COPd	2.50	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.013	KW	Rated heat output	Psup	1.90	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.013	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	65	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency	Nwh	134	%
Primary standby heat loss		1.85	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		350	L

TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				RAS-5WHVNPE / RWD-5NWE-260S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	12	KW	Seasonal Space Heating Energy Efficiency	N ^s	133	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	10.25	KW	Tj = -7 °C	COPd	1.70	-
Tj = +2 °C	Pdh	6.24	KW	Tj = +2 °C	COPd	3.60	-
Tj = +7 °C	Pdh	4.01	KW	Tj = +7 °C	COPd	4.60	-
Tj = +12 °C	Pdh	3.50	KW	Tj = +12 °C	COPd	5.50	-
Tj = operation limit temperature	Pdh	9.00	KW	Tj = operation limit temperature	COPd	1.60	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.013	KW	Rated heat output	Psup	2.60	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.013	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	65	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency	Nwh	134	%
Primary standby heat loss		1.85	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		350	L

PRODUCT LABELS – HEAT PUMP COMBINATION HEATER

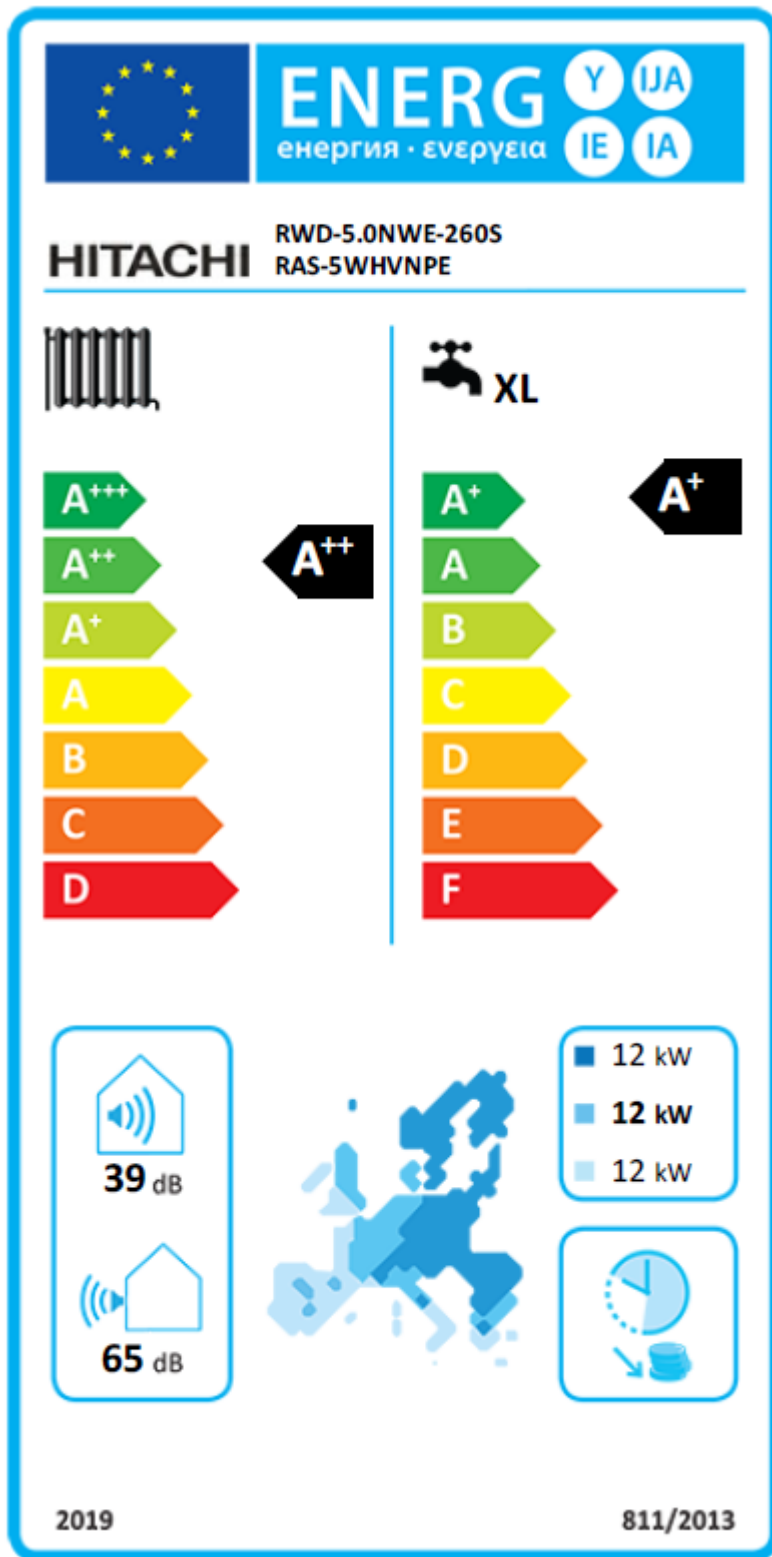

HITACHI
Inspire the Next

16 KW SPLIT TANK COMBI

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Hitachi YUTAKI Split Tank Combi air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: HTIACHI YUTAKI S COMBI
Model(s): RAS-6WHVNPE / RWD-6NWE-260S



Declaration & Applicable Standards

The product above is in compliance with the following directives.
Of the European Parliament and of the Council of the European Union:

2014/35/EU (2006/95/EC)
2014/30/EU (2004/108/EC)
2011/65/EU
813/2013 2009/125/EC

EN60335-1	EN60335-2-40
EN55014-1	EN55014-2
EN61000-3-3	EN61000-3-2
EN6100-3-11	EN61000-3-12
EN62233	EN14825
EN16147	EN12102

TECHNICAL PARAMETERS – LOW TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013


model				RAS-6WHVNPE / RWD-6NWE-260S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	16	KW	Seasonal Space Heating Energy Efficiency	N ^s	153	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	13.80	KW	Tj = -7 °C	COPd	2.40	-
Tj = +2 °C	Pdh	8.40	KW	Tj = +2 °C	COPd	3.90	-
Tj = +7 °C	Pdh	5.40	KW	Tj = +7 °C	COPd	5.00	-
Tj = +12 °C	Pdh	3.50	KW	Tj = +12 °C	COPd	6.00	-
Tj = operation limit temperature	Pdh	14.10	KW	Tj = operation limit temperature	COPd	2.30	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.013	KW	Rated heat output	Psup	1.90	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.013	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	67	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency	Nwh	134	%
Primary standby heat loss		1.85	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		350	L

TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				RAS-6WHVNPE / RWD-6NWE-260S			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				Yes			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	14	KW	Seasonal Space Heating Energy Efficiency	N ^s	125	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	11.20	KW	Tj = -7 °C	COPd	1.60	-
Tj = +2 °C	Pdh	6.82	KW	Tj = +2 °C	COPd	3.35	-
Tj = +7 °C	Pdh	4.38	KW	Tj = +7 °C	COPd	4.35	-
Tj = +12 °C	Pdh	3.60	KW	Tj = +12 °C	COPd	5.50	-
Tj = operation limit temperature	Pdh	10.50	KW	Tj = operation limit temperature	COPd	1.40	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.90	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.013	KW	Rated heat output	Psup	3.10	KW
Thermostat-off mode	P to	0	KW	Type of energy input Electricity			
Standby Mode	P sb	0.013	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	65	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency	Nwh	134	%
Primary standby heat loss		1.85	KWh/day	Reference hot water temperature		54	°C
				DHW volume accounted for in test		350	L

PRODUCT LABELS – HEAT PUMP COMBINATION HEATER

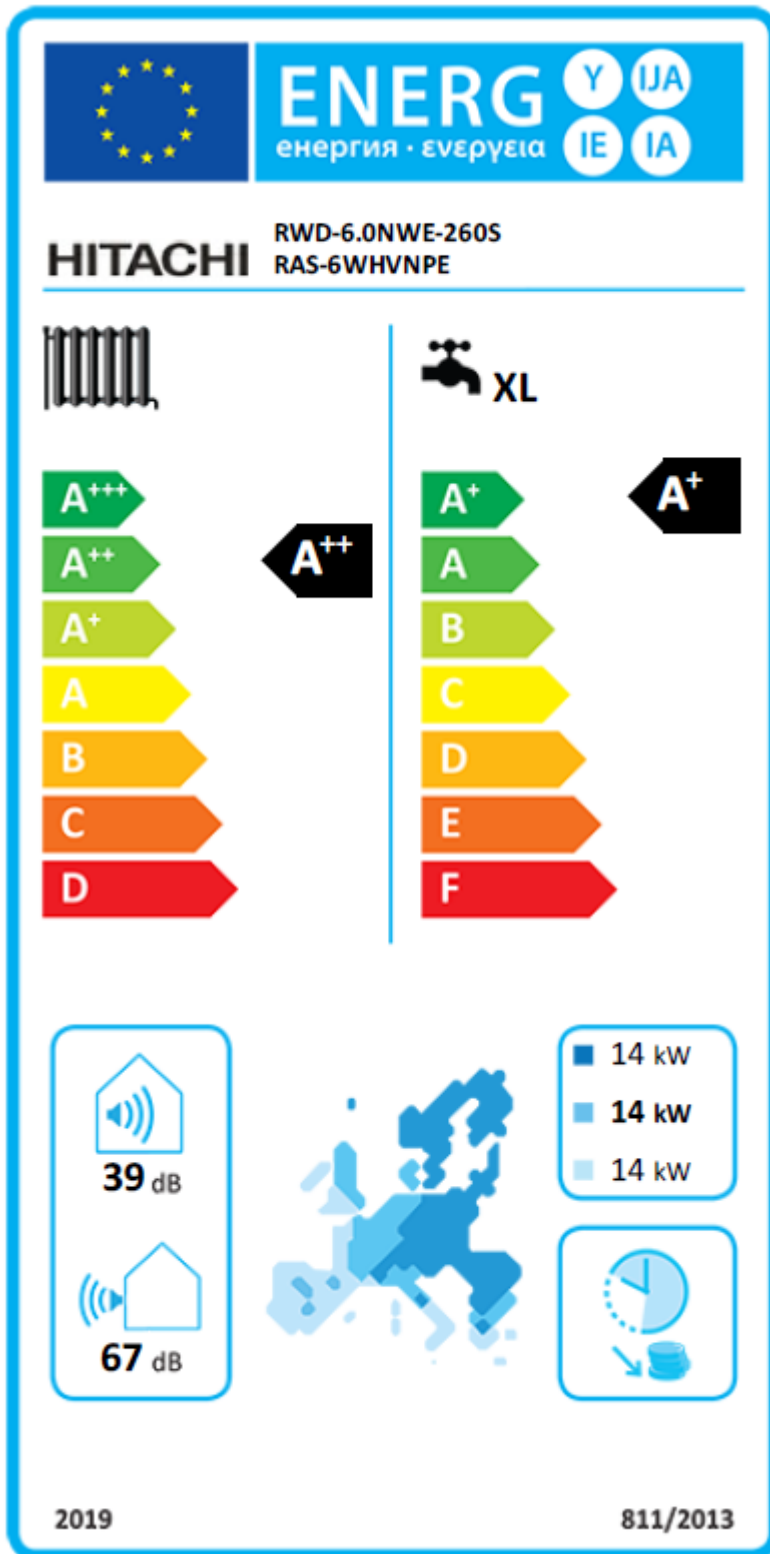



**For any queries on any information in this guide
or if you require anymore information please contact:**

PIPELIFE Ireland Limited, White's Cross, Cork,
1B Damastown Way, Mulhuddart, Dublin 15,
T +353 21 488 4700, **F** +353 21 488 4701,
E ireland@pipelife.com **pipelife.ie**