


ECODESIGN & ENERGY LABELLING INFORMATION



CONTENTS

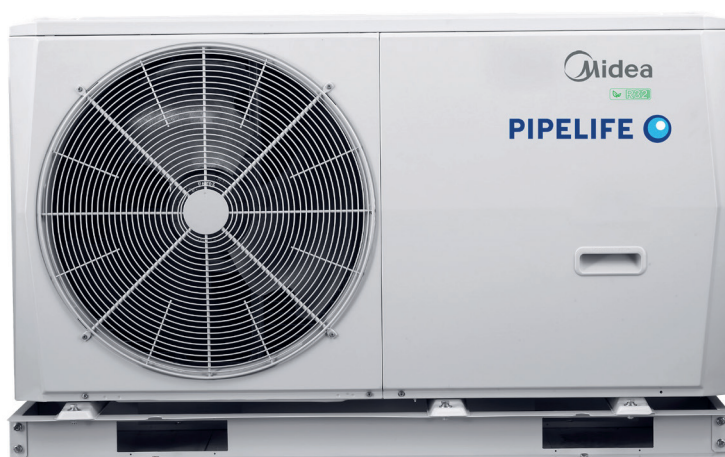

4KW MONOBLOC MHC-V4W/D2N8	3
6KW MONOBLOC MHC-V6W/D2N8-B	8
8KW MONOBLOC MHC-V8W/D2N8-B	13
10KW MONOBLOC MHC-V10W/D2N8-B	18
12KW MONOBLOC MHC-V12W/D2N-B	23
14KW MONOBLOC MHC-V14W/D2N8-B	28
16KW MONOBLOC MHC-V16W/D2N8-B	33



4KW MONOBLOC MHC-V4W/D2N8

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Midea 4KW monobloc air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: Space Heater , Outdoor Unit
Model(s): MHC-V4W/D2N8-B



Declaration & Applicable Standards

The Attestation of Conformity is issued on a voluntary basis according to the Directive 2014/30/EU relating to electromagnetic Compatibility. It confirms that the listed apparatus complies with all Essential requirements of the directive and is based on the technical Specifications applicable at the time of issuance. It refers only to the Particular sample submitted for testing and certification.

EN 55014-1:2017 EN55014-2:2015
EN IEC 61000-3-2:2019 EN IEC 61000-3-11:2019
EN 61000-3-3:2013/A1:2019 EN 61000-3-12:2011

Issue Date – 28/05/2020

The Attestation of Conformity is issued on a voluntary basis According to Council Directive 2006/42/EC relating to machinery. It Confirms that the listed equipment (not annex IV equipment) Complies with the principal protection requirements of the directive.

EN 60335-1:2012/A2:2019
EN 60355-2-40:2003/A13:2012
EN 62233:2008

Issue Date – 02/06/2020

TUV certification available upon request.

TECHNICAL PARAMETERS –

LOW TEMPERATURE APPLICATION 35 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013



model				MHC-V4W/D2N8-B & 200LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	4.6	KW	Seasonal Space Heating Energy Efficiency	N ^s	132	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	4.68	KW	Tj = -7 °C	COPd	3.13	-
Tj = +2 °C	Pdh	3.24	KW	Tj = +2 °C	COPd	6.02	-
Tj = +7 °C	Pdh	2.1	KW	Tj = +7 °C	COPd	7.4	-
Tj = +12 °C	Pdh	2	KW	Tj = +12 °C	COPd	9.2	-
Tj = operation limit temperature	Pdh	4.42	KW	Tj = operation limit temperature	COPd	2.86	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	55	dB
For heat pump combination heater							
Declared load profile	L			Water heating energy Efficiency	Nwh	115.1	%
Primary standby heat loss	1.296	kWh/24hr		Reference hot water temperature		49.08	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		200	L

TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION 55 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V4W/D2N8-B & 200LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	4.4	KW	Seasonal Space Heating Energy Efficiency	N ^s	130	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	5.03	KW	Tj = -7 °C	COPd	2.11	-
Tj = +2 °C	Pdh	3.21	KW	Tj = +2 °C	COPd	4.03	-
Tj = +7 °C	Pdh	2.20	KW	Tj = +7 °C	COPd	5.1	-
Tj = +12 °C	Pdh	1.78	KW	Tj = +12 °C	COPd	6.15	-
Tj = operation limit temperature	Pdh	3.42	KW	Tj = operation limit temperature	COPd	1.91	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	56	dB
For heat pump combination heater							
Declared load profile	L			Water heating energy Efficiency	Nwh	115.1	%
Primary standby heat loss	1.296	kWh/24hr		Reference hot water temperature		49.08	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		200	L

PRODUCT LABELS – HEAT PUMP SPACE HEATER

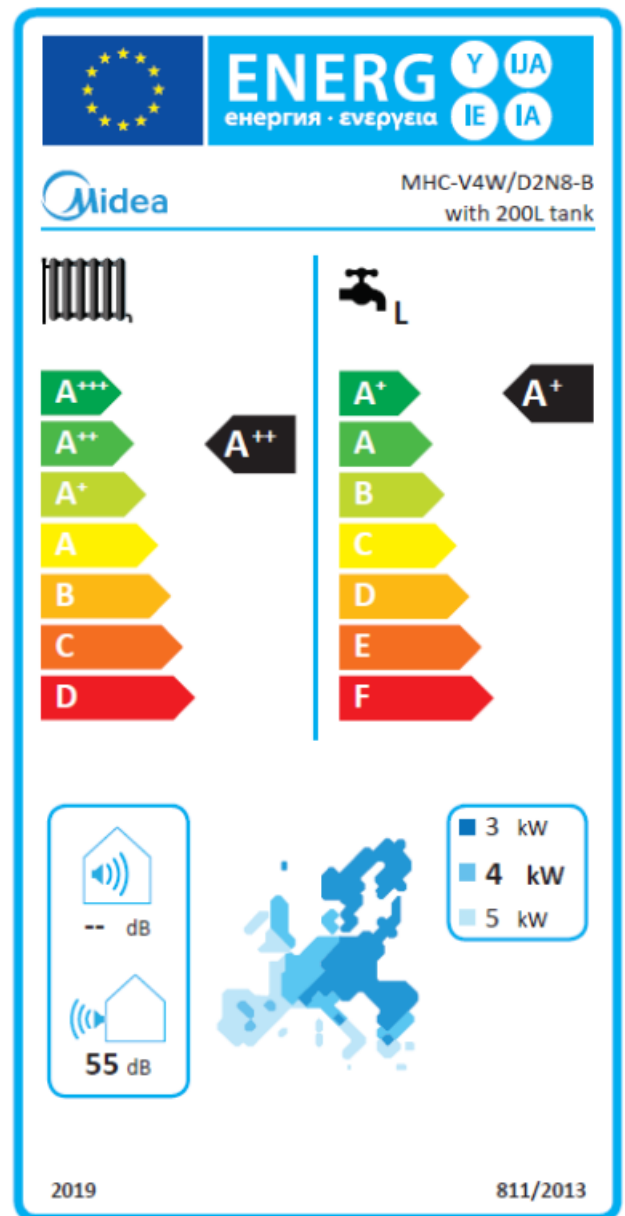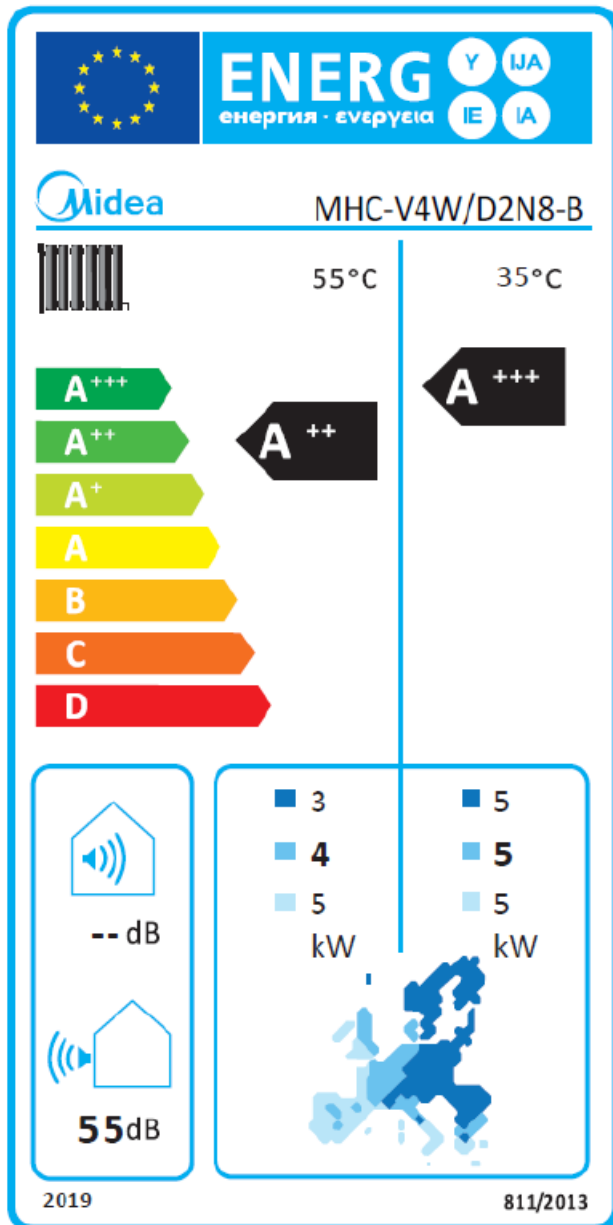



6KW MONOBLOC MHC-V6W/D2N8-B

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Midea 6KW monobloc air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: Space Heater , Outdoor Unit
Model(s): MHC-V6W/D2N8-B



Declaration & Applicable Standards

The Attestation of Conformity is issued on a voluntary basis according to the Directive 2014/30/EU relating to electromagnetic Compatibility. It confirms that the listed apparatus complies with all Essential requirements of the directive and is based on the technical Specifications applicable at the time of issuance. It refers only to the Particular sample submitted for testing and certification.

EN 55014-1:2017 EN55014-2:2015
EN IEC 61000-3-2:2019 EN IEC 61000-3-11:2019
EN 61000-3-3:2013/A1:2019 EN 61000-3-12:2011

Issue Date – 28/05/2020

The Attestation of Conformity is issued on a voluntary basis According to Council Directive 2006/42/EC relating to machinery. It Confirms that the listed equipment (not annex IV equipment) Complies with the principal protection requirements of the directive.

EN 60335-1:2012/A2:2019
EN 60355-2-40:2003/A13:2012
EN 62233:2008

Issue Date – 02/06/2020

TUV certification available upon request.

TECHNICAL PARAMETERS –

LOW TEMPERATURE APPLICATION 35 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013



model				MHC-V6W/D2N8-B & 200LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	6.82	KW	Seasonal Space Heating Energy Efficiency	N ^s	195	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	6.03	KW	Tj = -7 °C	COPd	3.13	-
Tj = +2 °C	Pdh	3.88	KW	Tj = +2 °C	COPd	6.02	-
Tj = +7 °C	Pdh	2.4	KW	Tj = +7 °C	COPd	7.4	-
Tj = +12 °C	Pdh	2	KW	Tj = +12 °C	COPd	9.2	-
Tj = operation limit temperature	Pdh	5.36	KW	Tj = operation limit temperature	COPd	2.76	-
Bivalent Temperature	Tbiv	-10	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.99	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	57	dB
For heat pump combination heater							
Declared load profile	L			Water heating energy Efficiency	Nwh	135.1	%
Primary standby heat loss	1.296	kWh/24hr		Reference hot water temperature		49.29	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		200	L

TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION 55 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V6W/D2N8-B & 200LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	5.7	KW	Seasonal Space Heating Energy Efficiency	N ^s	138	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	5.05	KW	Tj = -7 °C	COPd	2.17	-
Tj = +2 °C	Pdh	3.22	KW	Tj = +2 °C	COPd	4.01	-
Tj = +7 °C	Pdh	2.2	KW	Tj = +7 °C	COPd	5.1	-
Tj = +12 °C	Pdh	1.78	KW	Tj = +12 °C	COPd	6.15	-
Tj = operation limit temperature	Pdh	4.52	KW	Tj = operation limit temperature	COPd	1.91	-
Bivalent Temperature	Tbiv	-10	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	58	dB
For heat pump combination heater							
Declared load profile	L			Water heating energy Efficiency	Nwh	135.1	%
Primary standby heat loss	1.296	kWh/24hr		Reference hot water temperature		49.29	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		200	L

PRODUCT LABELS – HEAT PUMP SPACE HEATER

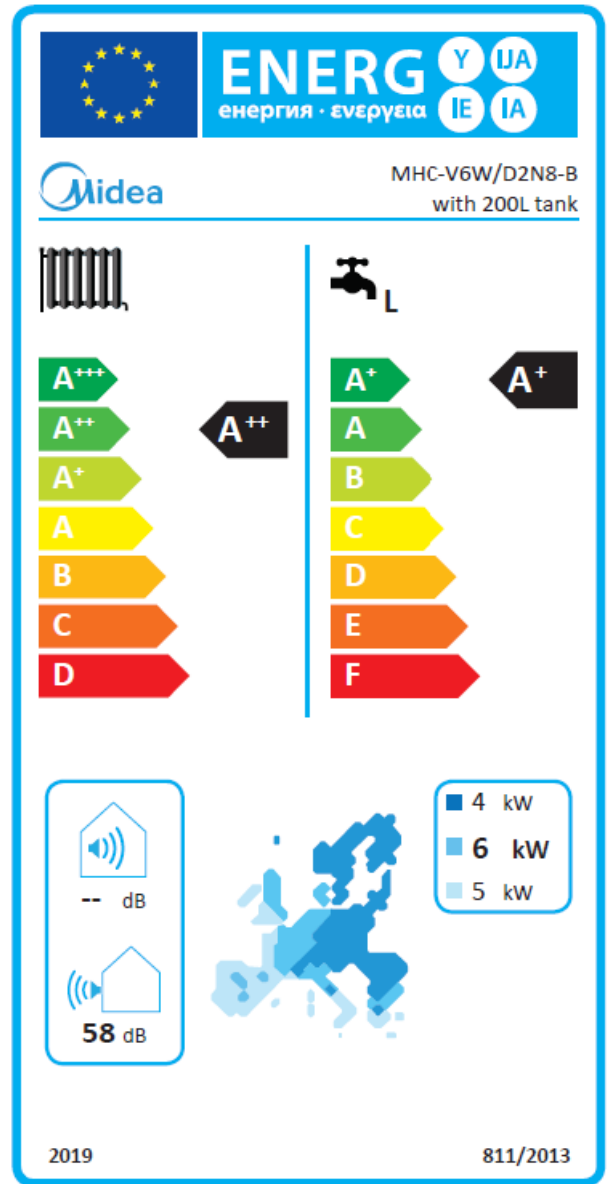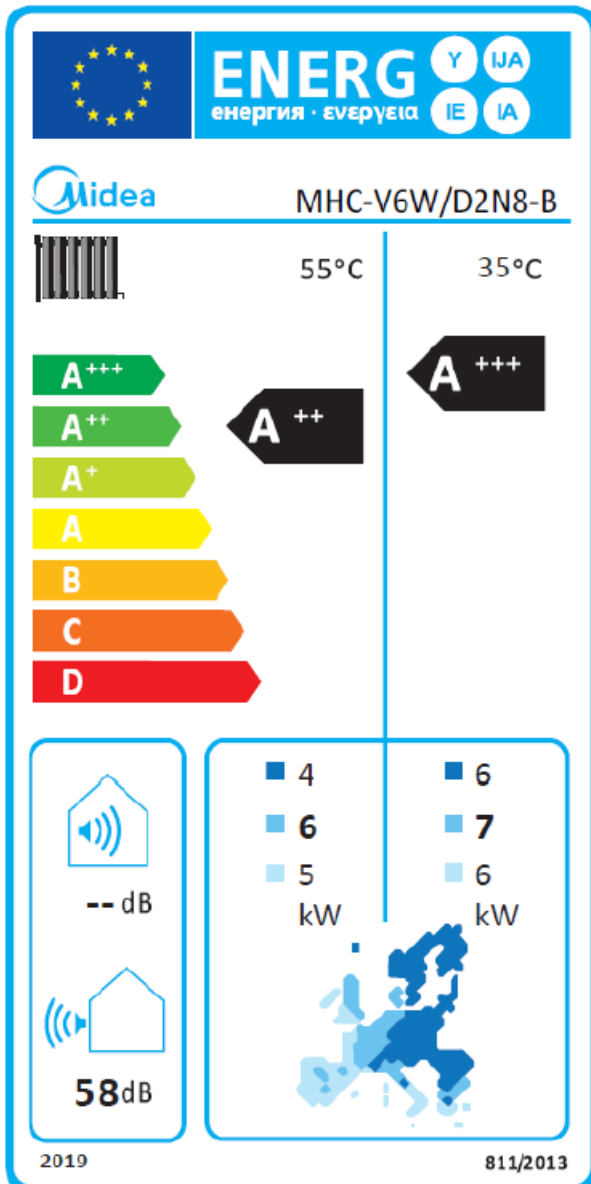



8KW MONOBLOC MHC-V8W/D2N8-B

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Midea 8KW monobloc air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: Space Heater , Outdoor Unit
Model(s): MHC-V8W/D2N8-B



Declaration & Applicable Standards

The Attestation of Conformity is issued on a voluntary basis according to the Directive 2014/30/EU relating to electromagnetic Compatibility. It confirms that the listed apparatus complies with all Essential requirements of the directive and is based on the technical Specifications applicable at the time of issuance. It refers only to the Particular sample submitted for testing and certification.

EN 55014-1:2017 EN55014-2:2015
EN IEC 61000-3-2:2019 EN IEC 61000-3-11:2019
EN 61000-3-3:2013/A1:2019 EN 61000-3-12:2011

Issue Date – 28/05/2020

The Attestation of Conformity is issued on a voluntary basis According to Council Directive 2006/42/EC relating to machinery. It Confirms that the listed equipment (not annex IV equipment) Complies with the principal protection requirements of the directive.

EN 60335-1:2012/A2:2019
EN 60355-2-40:2003/A13:2012
EN 62233:2008

Issue Date – 02/06/2020

TUV certification available upon request.

TECHNICAL PARAMETERS –

LOW TEMPERATURE APPLICATION 35 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V8W/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	8.12	KW	Seasonal Space Heating Energy Efficiency	N ^s	205	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	7.19	KW	Tj = -7 °C	COPd	3.35	-
Tj = +2 °C	Pdh	4.65	KW	Tj = +2 °C	COPd	5.09	-
Tj = +7 °C	Pdh	2.90	KW	Tj = +7 °C	COPd	6.82	-
Tj = +12 °C	Pdh	1.63	KW	Tj = +12 °C	COPd	8.35	-
Tj = operation limit temperature	Pdh	6.45	KW	Tj = operation limit temperature	COPd	3.04	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	55	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency Nwh		139	%
Primary standby heat loss		1.44	kWh/24hr	Reference hot water temperature		46.07	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L



TECHNICAL PARAMETERS –

MEDIUM TEMPERATURE APPLICATION 55 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V8W/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	6.60	KW	Seasonal Space Heating Energy Efficiency	N ^s	132	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	5.84	KW	Tj = -7 °C	COPd	2.16	-
Tj = +2 °C	Pdh	3.76	KW	Tj = +2 °C	COPd	3.30	-
Tj = +7 °C	Pdh	2.43	KW	Tj = +7 °C	COPd	4.34	-
Tj = +12 °C	Pdh	1.40	KW	Tj = +12 °C	COPd	5.33	-
Tj = operation limit temperature	Pdh	4.91	KW	Tj = operation limit temperature	COPd	1.84	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	56	dB
For heat pump combination heater							
Declared load profile	XL			Water heating energy Efficiency	Nwh	139	%
Primary standby heat loss	1.44	kWh/24hr		Reference hot water temperature		46.07	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L

PRODUCT LABELS – HEAT PUMP SPACE HEATER

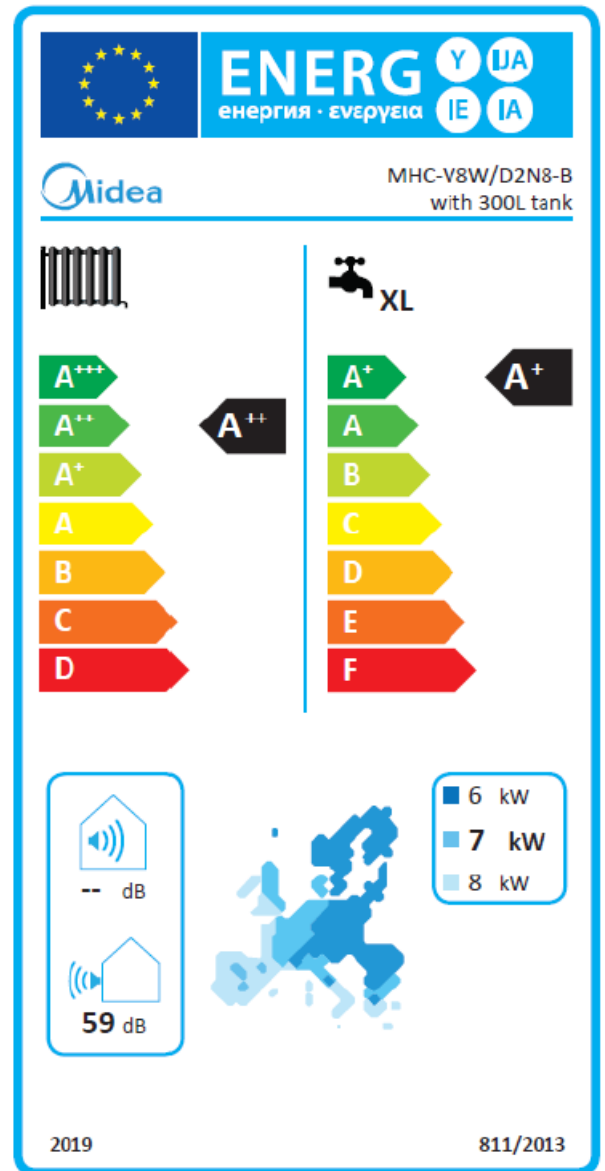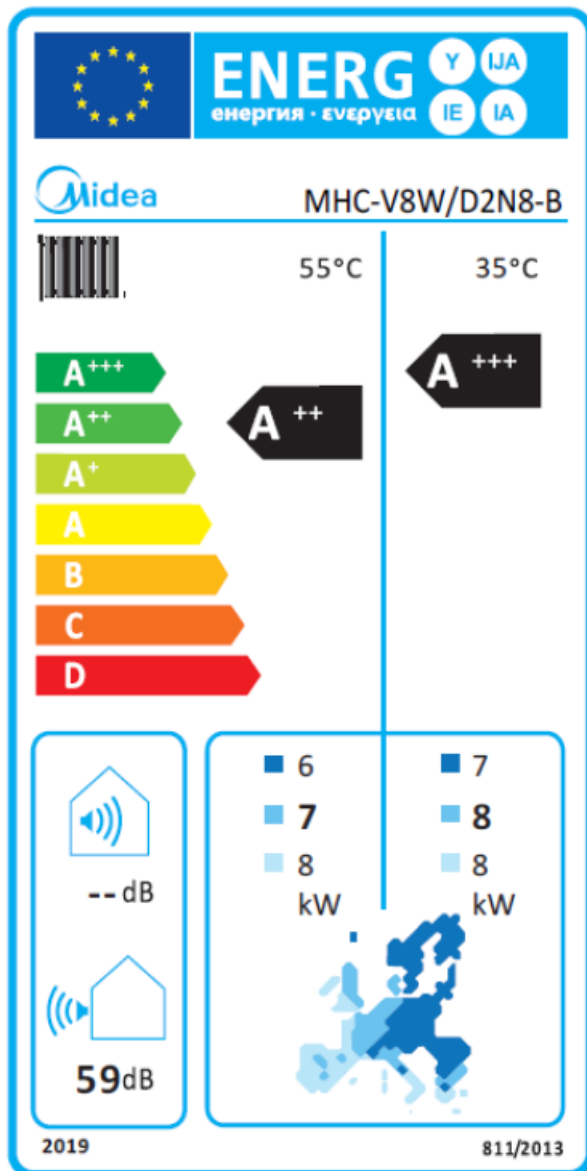



10KW MONOBLOC MHC-V10W/D2N8-B

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Midea 10KW monobloc air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: Space Heater , Outdoor Unit
Model(s): MHC-V10W/D2N8-B



Declaration & Applicable Standards

The Attestation of Conformity is issued on a voluntary basis according to the Directive 2014/30/EU relating to electromagnetic Compatibility. It confirms that the listed apparatus complies with all Essential requirements of the directive and is based on the technical Specifications applicable at the time of issuance. It refers only to the Particular sample submitted for testing and certification.

EN 55014-1:2017 EN55014-2:2015
EN IEC 61000-3-2:2019 EN IEC 61000-3-11:2019
EN 61000-3-3:2013/A1:2019 EN 61000-3-12:2011

Issue Date – 28/05/2020

The Attestation of Conformity is issued on a voluntary basis According to Council Directive 2006/42/EC relating to machinery. It Confirms that the listed equipment (not annex IV equipment) Complies with the principal protection requirements of the directive.

EN 60335-1:2012/A2:2019
EN 60355-2-40:2003/A13:2012
EN 62233:2008

Issue Date – 02/06/2020

TUV certification available upon request.

TECHNICAL PARAMETERS –

LOW TEMPERATURE APPLICATION 35 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-10VW/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	9.17	KW	Seasonal Space Heating Energy Efficiency	N ^s	205	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	8.11	KW	Tj = -7 °C	COPd	3.23	-
Tj = +2 °C	Pdh	5.18	KW	Tj = +2 °C	COPd	5.01	-
Tj = +7 °C	Pdh	3.32	KW	Tj = +7 °C	COPd	7.08	-
Tj = +12 °C	Pdh	1.65	KW	Tj = +12 °C	COPd	8.58	-
Tj = operation limit temperature	Pdh	7.40	KW	Tj = operation limit temperature	COPd	2.96	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	57	dB
For heat pump combination heater							
Declared load profile	XL			Water heating energy Efficiency	Nwh	139	%
Primary standby heat loss	1.44	kWh/24hr		Reference hot water temperature		46.07	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L



TECHNICAL PARAMETERS –

MEDIUM TEMPERATURE APPLICATION 55 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V10W/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	7.67	KW	Seasonal Space Heating Energy Efficiency	N ^s	137	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	6.78	KW	Tj = -7 °C	COPd	2.24	-
Tj = +2 °C	Pdh	4.29	KW	Tj = +2 °C	COPd	3.42	-
Tj = +7 °C	Pdh	2.77	KW	Tj = +7 °C	COPd	4.52	-
Tj = +12 °C	Pdh	1.58	KW	Tj = +12 °C	COPd	5.68	-
Tj = operation limit temperature	Pdh	5.39	KW	Tj = operation limit temperature	COPd	1.83	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	58	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency Nwh		139	%
Primary standby heat loss		1.44	kWh/24hr	Reference hot water temperature		46.07	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L

PRODUCT LABELS – HEAT PUMP SPACE HEATER

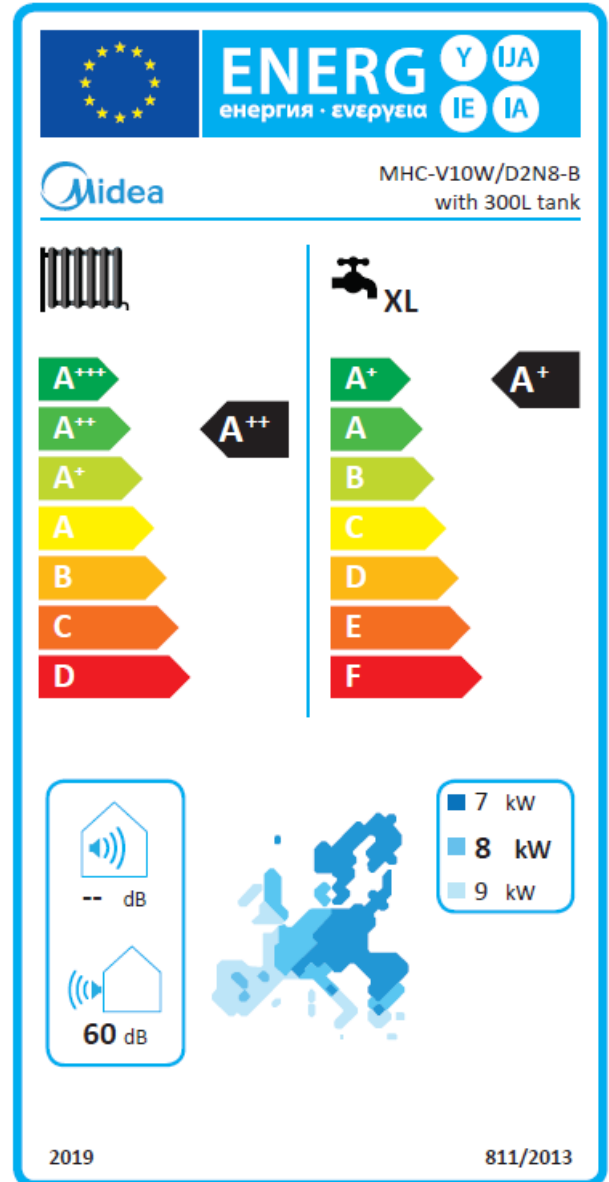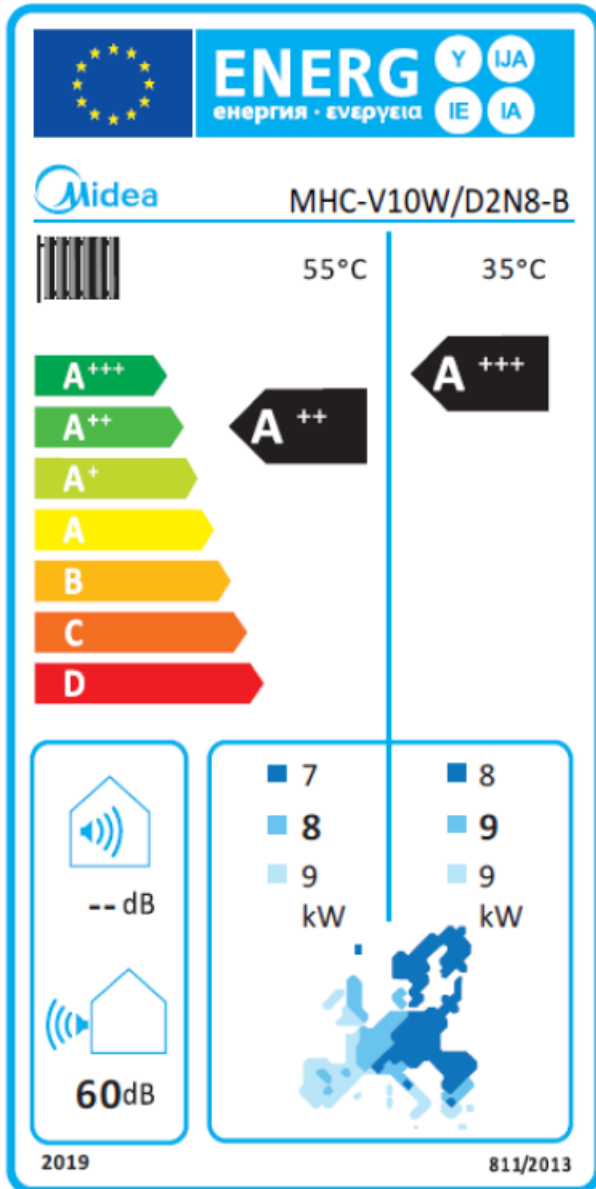



12KW MONOBLOC MHC-V12W/D2N-B

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Midea 12KW monobloc air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: Space Heater, Outdoor Unit
Model(s): MHC-V12W/D2N8-B



Declaration & Applicable Standards

The Attestation of Conformity is issued on a voluntary basis according to the Directive 2014/30/EU relating to electromagnetic Compatibility. It confirms that the listed apparatus complies with all Essential requirements of the directive and is based on the technical Specifications applicable at the time of issuance. It refers only to the Particular sample submitted for testing and certification.

EN 55014-1:2017 EN55014-2:2015
EN IEC 61000-3-2:2019 EN IEC 61000-3-11:2019
EN 61000-3-3:2013/A1:2019 EN 61000-3-12:2011

Issue Date – 28/05/2020

The Attestation of Conformity is issued on a voluntary basis According to Council Directive 2006/42/EC relating to machinery. It Confirms that the listed equipment (not annex IV equipment) Complies with the principal protection requirements of the directive.

EN 60335-1:2012/A2:2019
EN 60355-2-40:2003/A13:2012
EN 62233:2008

Issue Date – 02/06/2020

TUV certification available upon request.

TECHNICAL PARAMETERS –

LOW TEMPERATURE APPLICATION 35 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013



model				MHC-V12W/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	12	KW	Seasonal Space Heating Energy Efficiency	N ^s	189	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	10.61	KW	Tj = -7 °C	COPd	2.88	-
Tj = +2 °C	Pdh	6.69	KW	Tj = +2 °C	COPd	4.65	-
Tj = +7 °C	Pdh	4.44	KW	Tj = +7 °C	COPd	6.62	-
Tj = +12 °C	Pdh	3.74	KW	Tj = +12 °C	COPd	8.47	-
Tj = operation limit temperature	Pdh	10.75	KW	Tj = operation limit temperature	COPd	2.77	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	64	dB
For heat pump combination heater							
Declared load profile	XL			Water heating energy Efficiency	Nwh	130	%
Primary standby heat loss	1.752	kWh/24hr		Reference hot water temperature		47.15	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L

TECHNICAL PARAMETERS – MEDIUM TEMPERATURE APPLICATION 55 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V12W/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	11.58	KW	Seasonal Space Heating Energy Efficiency	N ^s	135	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	10.25	KW	Tj = -7 °C	COPd	2.01	-
Tj = +2 °C	Pdh	6.52	KW	Tj = +2 °C	COPd	3.44	-
Tj = +7 °C	Pdh	4.36	KW	Tj = +7 °C	COPd	4.59	-
Tj = +12 °C	Pdh	3.30	KW	Tj = +12 °C	COPd	6.05	-
Tj = operation limit temperature	Pdh	9.10	KW	Tj = operation limit temperature	COPd	1.79	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	64	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency Nwh		130	%
Primary standby heat loss		1.752	kWh/24hr	Reference hot water temperature		47.15	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L

PRODUCT LABELS – HEAT PUMP SPACE HEATER

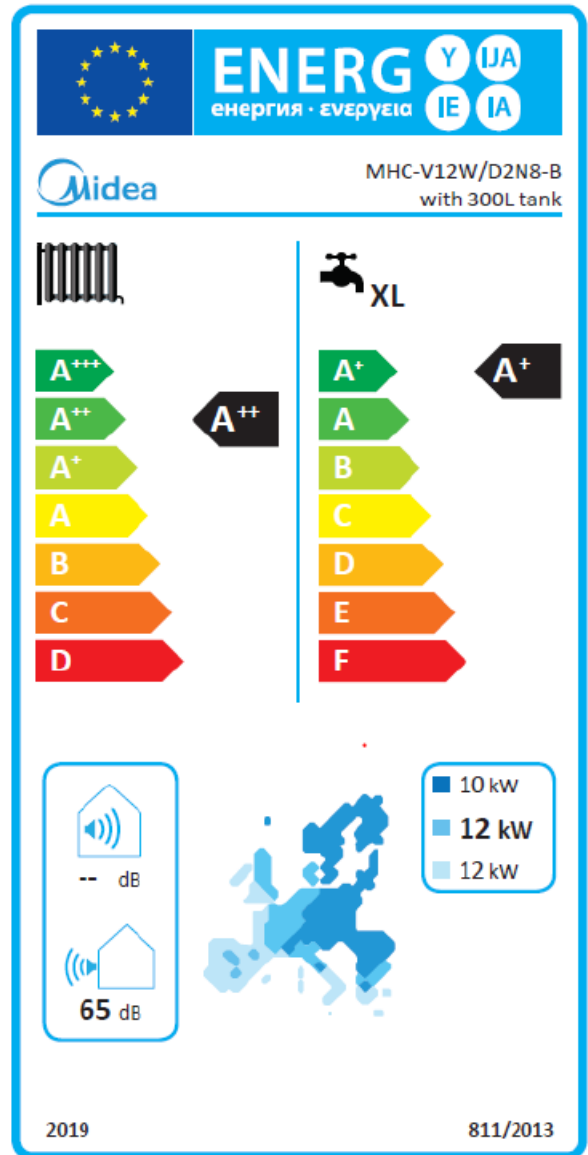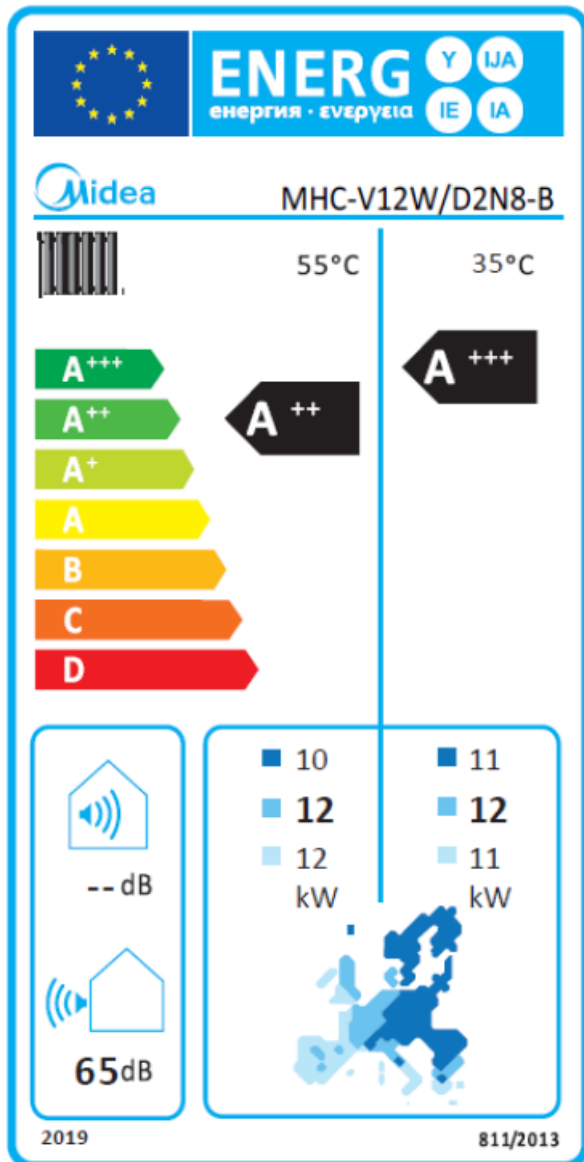



14KW MONOBLOC MHC-V14W/D2N8-B

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Midea 14KW monobloc air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: Space Heater, Outdoor Unit
Model(s): MHC-V14W/D2N8-B



Declaration & Applicable Standards

The Attestation of Conformity is issued on a voluntary basis according to the Directive 2014/30/EU relating to electromagnetic Compatibility. It confirms that the listed apparatus complies with all Essential requirements of the directive and is based on the technical Specifications applicable at the time of issuance. It refers only to the Particular sample submitted for testing and certification.

EN 55014-1:2017 EN55014-2:2015
EN IEC 61000-3-2:2019 EN IEC 61000-3-11:2019
EN 61000-3-3:2013/A1:2019 EN 61000-3-12:2011

Issue Date – 28/05/2020

The Attestation of Conformity is issued on a voluntary basis According to Council Directive 2006/42/EC relating to machinery. It Confirms that the listed equipment (not annex IV equipment) Complies with the principal protection requirements of the directive.

EN 60335-1:2012/A2:2019
EN 60355-2-40:2003/A13:2012
EN 62233:2008

Issue Date – 02/06/2020

TUV certification available upon request.

TECHNICAL PARAMETERS –

LOW TEMPERATURE APPLICATION 35 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V14W/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	13.73	KW	Seasonal Space Heating Energy Efficiency	N ^s	186	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	12.14	KW	Tj = -7 °C	COPd	2.79	-
Tj = +2 °C	Pdh	7.95	KW	Tj = +2 °C	COPd	4.52	-
Tj = +7 °C	Pdh	5.20	KW	Tj = +7 °C	COPd	6.68	-
Tj = +12 °C	Pdh	3.76	KW	Tj = +12 °C	COPd	8.52	-
Tj = operation limit temperature	Pdh	11.48	KW	Tj = operation limit temperature	COPd	2.59	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	65	dB
For heat pump combination heater							
Declared load profile	XL			Water heating energy Efficiency	Nwh	130	%
Primary standby heat loss	1.752	kWh/24hr		Reference hot water temperature		47.15	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L



TECHNICAL PARAMETERS –

MEDIUM TEMPERATURE APPLICATION 55 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V14W/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	12.08	KW	Seasonal Space Heating Energy Efficiency	N ^s	136	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	10.69	KW	Tj = -7 °C	COPd	2.01	-
Tj = +2 °C	Pdh	6.86	KW	Tj = +2 °C	COPd	3.43	-
Tj = +7 °C	Pdh	4.64	KW	Tj = +7 °C	COPd	4.66	-
Tj = +12 °C	Pdh	3.32	KW	Tj = +12 °C	COPd	6.13	-
Tj = operation limit temperature	Pdh	9.19	KW	Tj = operation limit temperature	COPd	1.76	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	65	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency Nwh		130	%
Primary standby heat loss		1.752	kWh/24hr	Reference hot water temperature		47.15	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L

PRODUCT LABELS – HEAT PUMP SPACE HEATER

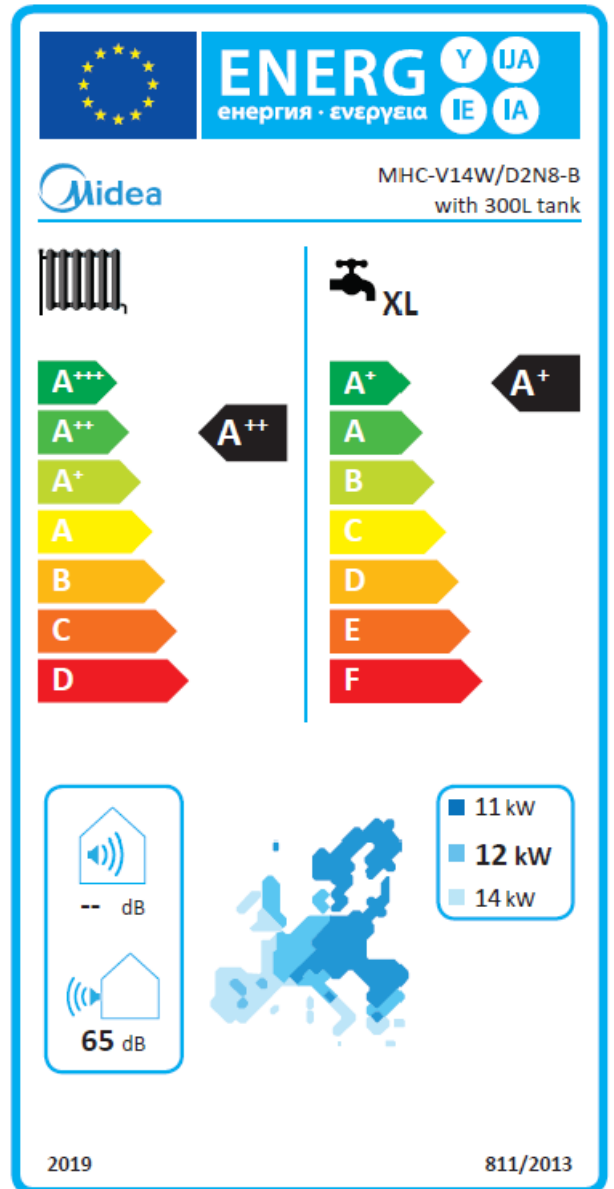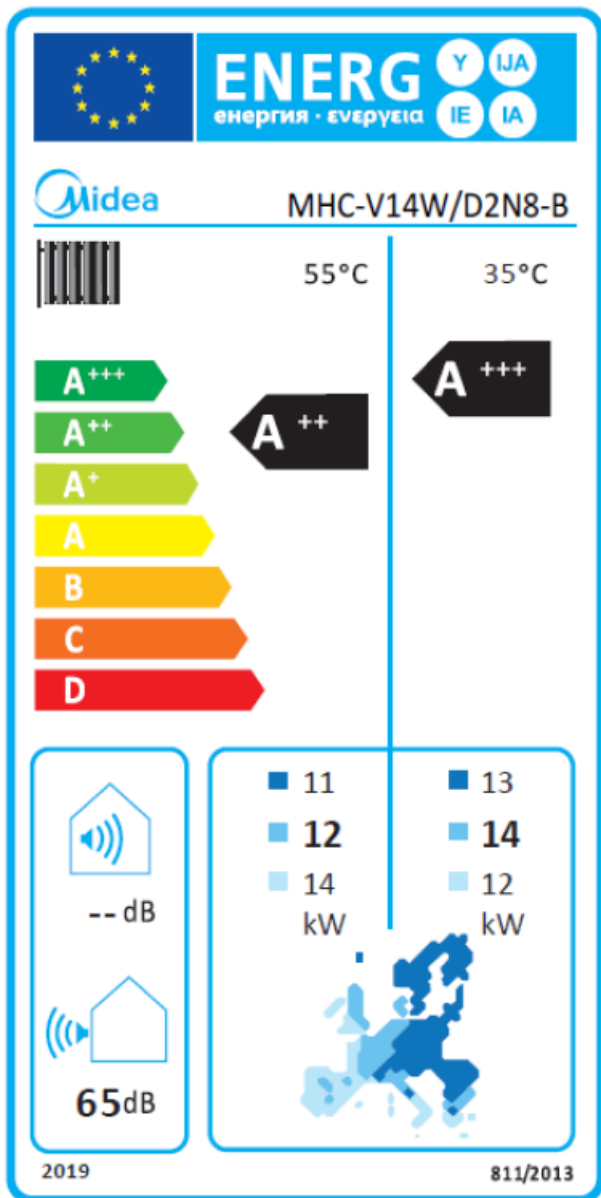



16KW MONOBLOC MHC-V16W/D2N8-B

INTRODUCTION

Welcome to the Eco design and Energy labelling data for the Midea 16KW monobloc air to water heat pump – by Pipelife Ireland LTD.

This document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike.

The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

DECLARATION OF CONFORMITY

Product details

Product: Space Heater, Outdoor Unit
Model(s): MHC-V16W/D2N8-B



Declaration & Applicable Standards

The Attestation of Conformity is issued on a voluntary basis according to the Directive 2014/30/EU relating to electromagnetic Compatibility. It confirms that the listed apparatus complies with all Essential requirements of the directive and is based on the technical Specifications applicable at the time of issuance. It refers only to the Particular sample submitted for testing and certification.

EN 55014-1:2017 EN55014-2:2015
EN IEC 61000-3-2:2019 EN IEC 61000-3-11:2019
EN 61000-3-3:2013/A1:2019 EN 61000-3-12:2011

Issue Date – 28/05/2020

The Attestation of Conformity is issued on a voluntary basis According to Council Directive 2006/42/EC relating to machinery. It Confirms that the listed equipment (not annex IV equipment) Complies with the principal protection requirements of the directive.

EN 60335-1:2012/A2:2019
EN 60355-2-40:2003/A13:2012
EN 62233:2008

Issue Date – 02/06/2020

TUV certification available upon request.

TECHNICAL PARAMETERS –

LOW TEMPERATURE APPLICATION 35 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V16W/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				Yes			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Low-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	15.21	KW	Seasonal Space Heating Energy Efficiency	N ^s	182	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	13.45	KW	Tj = -7 °C	COPd	2.72	-
Tj = +2 °C	Pdh	8.57	KW	Tj = +2 °C	COPd	4.41	-
Tj = +7 °C	Pdh	5.70	KW	Tj = +7 °C	COPd	6.56	-
Tj = +12 °C	Pdh	3.78	KW	Tj = +12 °C	COPd	8.51	-
Tj = operation limit temperature	Pdh	12.52	KW	Tj = operation limit temperature	COPd	2.48	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control	Variable			Outdoor sound level	Lwa	68	dB
For heat pump combination heater							
Declared load profile	XL			Water heating energy Efficiency	Nwh	130	%
Primary standby heat loss	1.752	kWh/24hr		Reference hot water temperature		47.15	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L



TECHNICAL PARAMETERS –

MEDIUM TEMPERATURE APPLICATION 55 Degrees

Information requirements for heat pump space heaters and heat pump combination heaters - 813/2013

model				MHC-V16W/D2N8-B & 300LTR cylinder			
Air-to-water heat pump				Yes			
Water-to-water heat pump				No			
Brine-to-water heat pump				No			
Low-temperature heat pump				No			
Equipped with supplementary heater				No			
heat pump combination heater				Yes			
Parameters are declared for				Medium-temperature application			
Parameters are declared for				Average climate conditions			
Item	Symbol	Value	unit	Item	Symbol	Value	unit
Rated heat output	Prated	13.02	KW	Seasonal Space Heating Energy Efficiency	N ^s	133	%
Declared capacity for heating for part load at indoor temperature 20 °C and outdoor temperature Tj				Declared coefficient of performance for part load at indoor temperature 20 °C and outdoor temperature Tj			
Tj = -7 °C	Pdh	11.52	KW	Tj = -7 °C	COPd	1.99	-
Tj = +2 °C	Pdh	7.18	KW	Tj = +2 °C	COPd	3.34	-
Tj = +7 °C	Pdh	4.68	KW	Tj = +7 °C	COPd	4.61	-
Tj = +12 °C	Pdh	3.32	KW	Tj = +12 °C	COPd	6.07	-
Tj = operation limit temperature	Pdh	10.33	KW	Tj = operation limit temperature	COPd	1.80	-
Bivalent Temperature	Tbiv	-7	°C	operation limit temperature	TOL	-10	°C
Degradation co-efficient	Cdh	0.9	-	Heating water operating limit temperature	WTOL	65	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	P off	0.014	KW	Rated heat output	Psup		KW
Thermostat-off mode	P to	0.014	KW	Type of energy input Electricity			
Standby Mode	P sb	0.024	KW				
Crankcase heater mode	P ck	0	KW				
Other modes							
Capacity control		Variable		Outdoor sound level	Lwa	68	dB
For heat pump combination heater							
Declared load profile		XL		Water heating energy Efficiency Nwh		130	%
Primary standby heat loss		1.752	kWh/24hr	Reference hot water temperature		47.15	°C
Central Heating Pump EEI ≥ 0.21 Central Heating Pump Electricity Consumption (kwh/y) – 27 (kwh/y)				DHW volume accounted for in test		300	L

PRODUCT LABELS – HEAT PUMP SPACE HEATER

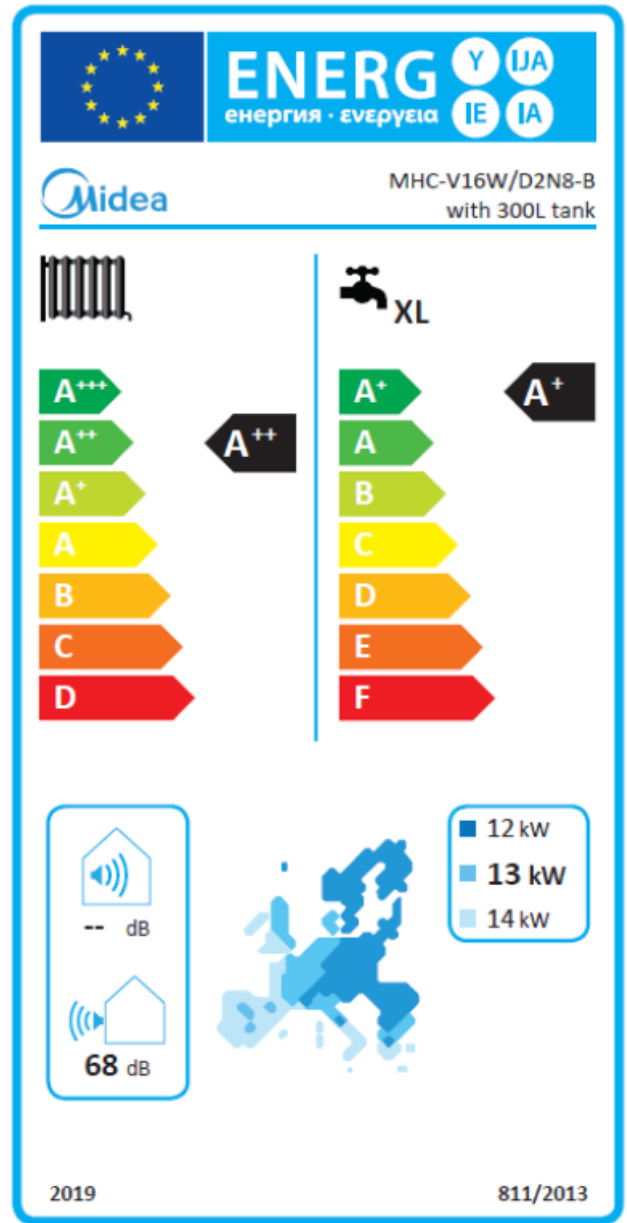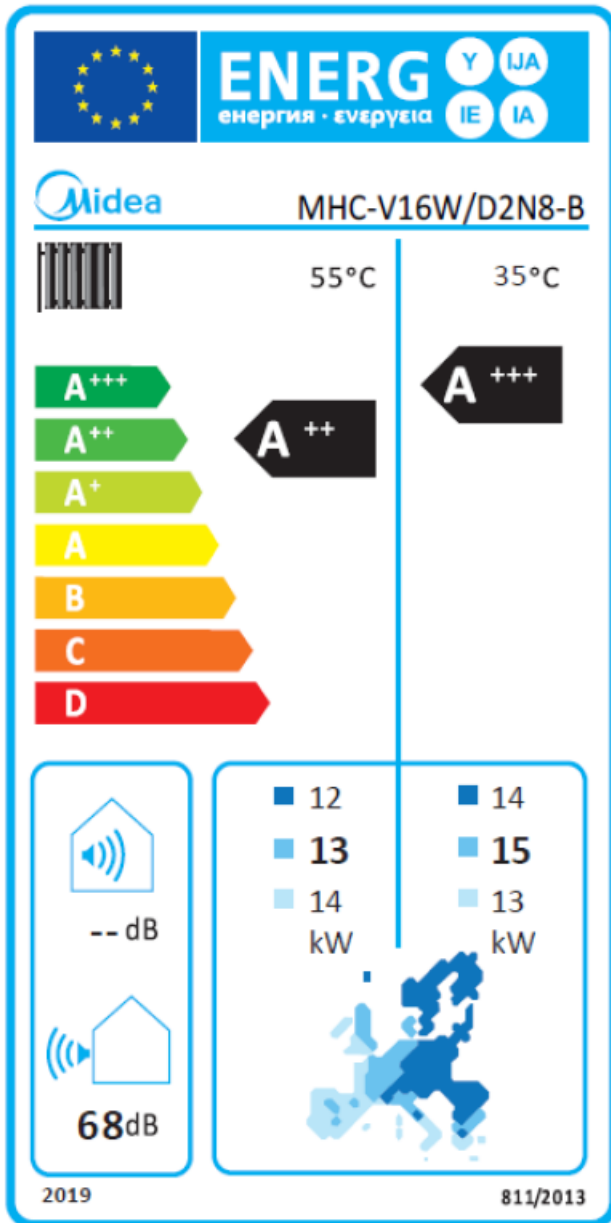



**For any queries on any information in this guide
or if you require anymore information please contact:**

PIPELIFE Ireland Limited, Little Island, Cork, T45 TX05,
1B Damastown Way, Mulhuddart, Dublin 15,
T +353 21 488 4700 **E** ireland@pipelife.com **pipelife.ie**